

FIT¹

UP TO 21.0 SEER2 & 10.0 HSPF2
2 AND 3 TONS

Contents

Nomenclature.....	2
Product Specifications.....	3
Expanded Cooling Data.....	4
Expanded Heating Data.....	8
Performance Data.....	10
Sound Data	
Sound Power.....	11
Quiet Mode.....	12
Sound Pressure.....	13
AHRI Ratings (see note).....	14
Dimensions.....	15
Wiring Diagrams.....	16
Accessories.....	17

R32

Standard Features

- Daikin variable-speed swing compressor
- Strong heating capacity (Met the requirements of the U.S. Department of Energy (DOE) Residential Cold Climate Heat Pump Challenge)
- Suitable for high-ambient regions
- Quiet digitally commutated fan motor
- High-density compressor sound blanket
- Compatible with Daikin *One+* smart thermostat and other Daikin communicating equipment
- Daikin control algorithmic logic
- Compatible with AHRI 1380 Demand Response functionality
- Compatible with the *ONE* Ecosystem
- Intelligent Defrost Mode
- In communicating mode, only two low-voltage wires to outdoor unit required
- Diagnostic indicator lights, seven-segment LED display, and fault code storage
- Daikin Inside intelligence for diagnostics
- Quiet-mode - provides enhanced acoustical comfort, up to 3 different sound levels (as low as 47dBA)
- Field-selectable boost mode increases compressor speed during unusually high loads
- Field-installed bi-flow filter drier
- Coil and ambient temperature sensors
- Suction pressure transducer
- Sweat connection service valves with easy access to gauge ports
- Advanced water-shedding drain pan
- 3-Stage Heater Kit Available as a Field Installed Option
- Hot gas base pan eliminates extra drain pan heater down to 5°F
- Hot start technology
- AHRI Certified; ETL Listed

DAIKIN *FIT AURORA*
HIGH-EFFICIENCY, COMMUNICATING,
VARIABLE-SPEED,
INVERTER DRIVE SIDE DISCHARGE
R-32 SPLIT SYSTEM HEAT PUMP



Cabinet Features

- Heavy-gauge galvanized steel cabinet with grille-style sound control side design
- Custom Ivory white powder-paint finish
- 500-hour salt-spray tested
- High corrosion (ZAM®), unpainted steel bottom frame and legs
- Wire fan discharge grille
- Top and side maintenance access
- When properly anchored, meets the 2023 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



Products that are recognized as the Most Efficient of **ENERGY STAR®** in 2025 prevent greenhouse gas emissions by meeting rigorous energy efficiency performance levels set by the U.S. Environmental Protection Agency.

* Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet **ENERGY STAR®** criteria. Ask your contractor for details or visit www.energystar.gov.

Eligible for IRA Tax Credit
(Meets New CEE 2025 Specification)



* Complete warranty available from your local dealer or at www.daikincomfort.com. To receive the 12-Year Unit Replacement Limited Warranty and 12-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California, Florida, or Québec. The duration of warranty coverages in Texas and Florida differs in some cases. Other limitations and exclusions apply, refer to complete warranty details for full list of limitations and exclusions. Additional requirements for annual maintenance are required for the 12-Year Unit Replacement Limited Warranty. Changes in law, regulations, or technology may result in an equivalent unit not being available. Other limitations and exclusions apply, refer to complete warranty details for full list of limitations and exclusions, as well as rights and obligations should an equivalent unit not be available.

	D	H	9	V	S	A	18	1	C	A	A	
	1	2	3	4	5	6	7,8	9	10	11	12	
Brand D Daikin												Minor Revision A
Type H - Heat Pump R-32												Major Revision A
SEER2 19.0+ = 9												Variation C - ALL CLIMATE
Compressor V – Variable Speed												Electrical 1 – 208-230 V, 1 Phase, 60 Hz
Feature Set S – Side Discharge Communicating												Tonnage Nominal 24 - 2 tons 36 - 3 tons
												Sales Region A – All

	DH9VSA 241CA*	DH9VSA 361CA*
CAPACITIES (AHRI RATED)		
Max. Cooling (BTU/h)-95F	24,000	36,000
Max. Heating (BTU/h)-47F	24,000	36,000
Max. Heating (BTU/h)-5F	24,000	36,000
AMBIENT OPERATION RANGE		
Cooling (°FDB(°CDB))	0 to 115 (-17.8 to 46.1)	
Heating (°FDB(°CDB))	-10 to 70 (-23.3 to 21.1)	
COMPRESSOR		
Type	Swing	Swing
CONDENSER FAN MOTOR		
Horsepower	0.20	0.36
REFRIGERATION SYSTEM		
Refrigerant Line Size ¹		
Liquid Line Size ("O.D.)	3/8"	3/8"
Suction Line Size ("O.D.)	7/8"	7/8"
Refrigerant Connection Size		
Liquid Valve Size ("O.D.)	3/8"	3/8"
Suction Valve Size ("O.D.)	7/8"	7/8"
Valve Connection Type	Front and Back Sealing	Front and Back Sealing
Refrigerant Charge (oz.)	162	162
Expansion Device	EEV	EEV
Superheat at Service Valve	Auto-control	Auto-control
Subcooling at Service Valve	11±1°F	9±1°F
ELECTRICAL DATA		
Voltage / Phase (60 Hz)	208-230/1	208-230/1
Fan/Compressor Inverter Drive Input	8.0	12.0
Minimum Circuit Ampacity ²	17.4	21.8
Max. Overcurrent Protection ³	20	25
Min / Max Volts	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"
EQUIPMENT WEIGHT (LBS)	230	230
SHIP WEIGHT (LBS)	265	265
ENERGY STAR® CERTIFIED	 	 

¹ Tested and rated in accordance with AHRI Standard 210/240

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- Installer will need to supply 7/8" to 1 1/4" adapters for suction line connections.
- Unit is charged with refrigerant for 15' of 3/4" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.

(See table below for allowable line set diameter)

ENERGY STAR NOTES

Proper sizing and installation of equipment is critical to achieving optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet **ENERGY STAR** criteria. Ask your contractor for details or visit www.energystar.gov. The www.energystar.gov website provides up-to-date system combinations certified to meet **ENERGY STAR** requirements.

UNIT TONS	ALLOWABLE LINE SET DIAMETER				
	LIQUID		SUCTION		
	5/16"	3/8"	5/8"	3/4"	7/8"
2.0	X	X	X	X	X
3.0	X	X		X	X

x Allowable combination

OUTDOOR UNIT	DH9VS*361*A*	TRIM MORE THAN 5% SETTINGS ARE INVALID. TRIMMED UP CFM MAKES MISS MATCHING ERROR.
INDOOR UNIT	D*96TC0403B / 0603B	
	D*97MC0603B	
	D*80TC0603B / 0803B	
	D*96SC0603BU	

		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		ENTERING INDOOR WET BULB TEMPERATURE																							
IDB*	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
770	MBh	25.0	25.3	26.1		24.5	24.9	25.6		23.7	24.0	24.7		22.4	22.7	23.4		20.8	21.2	21.9		19.4	19.8	20.5	
	S/T	0.63	0.54	0.40		0.63	0.55	0.41		0.65	0.57	0.43		0.67	0.59	0.45		0.69	0.61	0.47		0.74	0.66	0.52	
	ΔT	20	18	15		20	18	14		19	18	14		19	17	14		18	17	13		19	17	14	
	kW	1.26	1.26	1.26		1.47	1.47	1.46		1.70	1.70	1.70		1.97	1.97	1.96		2.27	2.27	2.26		2.63	2.63	2.62	
	Amps	6.0	6.0	5.9		6.7	6.7	6.7		7.5	7.5	7.5		8.4	8.4	8.4		9.3	9.3	9.3		10.5	10.5	10.4	
900	Hi PR	218	219	221		257	258	260		299	300	301		345	346	347		395	396	397		450	451	452	
	Lo PR	129	133	140		133	137	144		136	140	147		137	141	148		138	142	149		140	143	151	
	MBh	25.4	25.7	26.5		24.9	25.3	26.0		24.0	24.4	25.1		22.7	23.1	23.8		21.2	21.5	22.3		19.8	20.1	20.9	
	S/T	0.71	0.63	0.48		0.71	0.63	0.49		0.73	0.65	0.51		0.75	0.67	0.53		0.77	0.69	0.55		0.82	0.74	0.60	
	ΔT	19	17	13		18	16	13		18	16	13		18	16	13		17	15	12		18	16	13	
1040	kW	1.27	1.27	1.27		1.48	1.48	1.47		1.71	1.71	1.71		1.98	1.98	1.97		2.28	2.28	2.28		2.64	2.64	2.64	
	Amps	6.0	6.0	6.0		6.8	6.8	6.7		7.6	7.6	7.6		8.4	8.4	8.4		9.4	9.4	9.4		10.5	10.5	10.5	
	Hi PR	221	222	223		260	260	262		301	302	304		347	348	350		397	398	400		452	453	455	
	Lo PR	132	135	143		135	139	147		138	142	149		139	143	150		140	144	151		142	145	153	
	MBh	25.8	26.2	26.9		25.4	25.7	26.5		24.5	24.9	25.6		23.2	23.6	24.3		21.7	22.0	22.7		20.3	20.6	21.3	
1040	S/T	0.75	0.67	0.52		0.75	0.67	0.53		0.77	0.69	0.55		0.79	0.71	0.57		0.81	0.73	0.59		0.99	0.78	0.64	
	ΔT	18	16	12		17	15	12		17	15	12		17	15	12		16	14	11		17	15	12	
	kW	1.28	1.28	1.28		1.49	1.48	1.48		1.72	1.72	1.72		1.99	1.98	1.98		2.29	2.29	2.28		2.65	2.65	2.65	
	Amps	6.1	6.0	6.0		6.8	6.8	6.8		7.6	7.6	7.6		8.5	8.5	8.5		9.4	9.4	9.4		10.5	10.5	10.5	
	Hi PR	223	224	225		262	263	264		303	304	306		349	350	352		400	401	402		454	455	457	
	Lo PR	134	138	145		138	142	149		140	144	152		142	145	153		142	146	153		144	148	155	

770	MBh	25.0	25.3	26.1	27.2	24.5	24.9	25.6	26.8	23.7	24.0	24.8	25.9	22.4	22.7	23.4	24.6	20.8	21.2	21.9	23.0	19.4	19.8	20.5	21.6
	S/T	0.76	0.68	0.54	0.39	1.00	0.69	0.54	0.39	1.00	0.71	0.57	0.42	1.00	0.73	0.58	0.44	1.00	0.75	0.61	0.46	0.99	0.80	0.66	0.51
	ΔT	24	22	19	15	24	22	18	15	23	22	18	15	23	21	18	14	22	20	17	14	23	21	18	15
	kW	1.26	1.26	1.26	1.27	1.47	1.46	1.46	1.47	1.70	1.70	1.70	1.71	1.97	1.96	1.96	1.97	2.27	2.27	2.26	2.28	2.63	2.63	2.62	2.64
	Amps	6.0	6.0	5.9	6.0	6.7	6.7	6.7	6.7	7.5	7.5	7.5	7.6	8.4	8.4	8.4	8.4	9.3	9.3	9.3	9.4	10.5	10.4	10.4	10.5
900	Hi PR	219	220	221	225	257	258	260	264	299	300	302	306	345	346	347	351	395	396	398	402	450	451	452	457
	Lo PR	129	133	140	152	133	137	144	156	136	140	147	158	137	141	148	159	138	142	149	160	140	144	151	162
	MBh	25.4	25.7	26.5	27.6	24.9	25.3	26.0	27.2	24.1	24.4	25.1	26.3	22.7	23.1	23.8	24.9	21.2	21.6	22.3	23.4	19.8	20.2	20.9	22.0
	S/T	0.84	0.76	0.62	0.47	1.00	0.77	0.62	0.47	1.00	0.79	0.65	0.50	1.00	0.81	0.66	0.51	1.00	0.83	0.68	0.54	0.99	0.88	0.74	0.59
	ΔT	23	21	17	14	22	20	17	14	22	20	17	14	21	20	16	13	21	19	16	13	21	20	17	13
1040	kW	1.27	1.27	1.27	1.28	1.48	1.47	1.47	1.48	1.71	1.71	1.71	1.72	1.98	1.97	1.97	1.99	2.28	2.28	2.27	2.29	2.64	2.64	2.64	2.65
	Amps	6.0	6.0	6.0	6.0	6.8	6.7	6.7	6.8	7.6	7.6	7.5	7.6	8.4	8.4	8.4	8.5	9.4	9.4	9.4	9.4	10.5	10.5	10.5	10.5
	Hi PR	221	222	223	227	260	261	262	266	301	302	304	308	347	348	350	354	397	398	400	404	452	453	455	459
	Lo PR	132	135	143	154	135	139	147	158	138	142	149	161	139	143	150	162	140	144	151	162	142	145	153	164
	MBh	25.9	26.2	27.0	28.1	25.4	25.8	26.5	27.6	24.5	24.9	25.6	26.7	23.2	23.6	24.3	25.4	21.7	22.0	22.7	23.9	20.3	20.6	21.3	22.4
1040	S/T	1.00	0.80	0.66	0.51	1.00	0.81	0.66	0.51	1.00	0.83	0.69	0.54	1.00	0.85	0.70	0.55	1.00	0.87	0.72	0.57	0.99	0.92	0.77	0.63
	ΔT	22	20	16	13	21	19	16	13	21	19	16	13	20	19	15	12	20	18	15	12	20	19	16	12
	kW	1.28	1.28	1.27	1.29	1.48	1.48	1.48	1.49	1.72	1.72	1.72	1.73	1.99	1.98	1.98	1.99	2.29	2.29	2.28	2.30	2.65	2.65	2.64	2.66
	Amps	6.0	6.0	6.0	6.1	6.8	6.8	6.8	6.8	7.6	7.6	7.6	7.6	8.5	8.5	8.5	8.5	9.4	9.4	9.4	9.5	10.5	10.5	10.5	10.6
	Hi PR	223	224	226	229	262	263	264	268	304	305	306	310	349	350	352	356	400	401	402	406	455	456	457	461
	Lo PR	134	138	145	157	138	142	149	161	140	144	152	163	142	146	153	164	142	146	153	165	144	148	155	166

IDB*: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Airflow may vary depending on actual ambient conditions and system operation modes.

Shaded area is ACCA (TVA) conditions

kW = Total system power
 Amps = outdoor unit amps

		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
IDB*	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
770	MBh	25.1	25.5	26.2	27.4	24.7	25.0	25.8	26.9	23.8	24.2	24.9	26.0	22.5	22.8	23.6	24.7	21.0	21.3	22.0	23.1	19.6	19.9	20.6	21.7
	S/T	1.00	0.81	0.67	0.52	1.00	0.82	0.67	0.52	1.00	0.84	0.70	0.55	1.00	0.86	0.72	0.57	1.00	0.88	0.74	0.59	0.99	0.93	0.79	0.64
	ΔT	28	26	23	19	28	26	22	19	27	26	22	19	26	25	22	18	26	24	21	18	26	25	21	18
	kW	1.26	1.26	1.26	1.27	1.47	1.47	1.46	1.47	1.70	1.70	1.70	1.71	1.97	1.96	1.96	1.98	2.27	2.27	2.26	2.28	2.63	2.63	2.62	2.64
	Amps	6.0	6.0	5.9	6.0	6.7	6.7	6.7	6.7	7.5	7.5	7.5	7.6	8.4	8.4	8.4	8.4	9.3	9.3	9.3	9.4	10.5	10.5	10.4	10.5
	Hi PR	219	220	222	225	258	259	260	264	299	300	302	306	345	346	348	352	395	396	398	402	450	451	453	457
80	Lo PR	130	134	141	152	134	138	145	156	136	140	148	159	138	142	149	160	138	142	149	161	140	144	151	162
	MBh	25.5	25.9	26.6	27.7	25.1	25.4	26.1	27.3	24.2	24.5	25.3	26.4	22.9	23.2	24.0	25.1	21.3	21.7	22.4	23.5	19.9	20.3	21.0	22.1
	S/T	1.00	0.89	0.75	0.60	1.00	0.90	0.75	0.60	1.00	0.92	0.78	0.63	1.00	0.94	0.80	0.65	1.00	0.96	0.82	0.67	0.99	0.99	0.87	0.72
	ΔT	27	25	22	18	26	24	21	18	26	24	21	17	25	23	20	17	24	23	20	16	25	23	20	17
	kW	1.27	1.27	1.27	1.28	1.48	1.48	1.47	1.48	1.71	1.71	1.71	1.72	1.98	1.98	1.97	2.01	2.28	2.28	2.28	2.29	2.64	2.64	2.64	2.65
	Amps	6.0	6.0	6.0	6.1	6.8	6.8	6.7	6.8	7.6	7.6	7.6	7.6	8.4	8.4	8.4	8.5	9.4	9.4	9.4	9.4	10.5	10.5	10.5	10.5
1040	Hi PR	221	222	224	228	260	261	263	267	302	303	304	308	348	349	350	354	398	399	401	405	453	454	455	459
	Lo PR	132	136	143	155	136	140	147	159	139	143	150	161	140	144	151	162	140	144	152	163	142	146	153	164
	MBh	26.0	26.3	27.1	28.2	25.5	25.9	26.6	27.8	24.7	25.0	25.7	26.9	23.3	23.7	24.4	25.5	21.8	22.1	22.9	24.0	20.4	20.7	21.5	22.6
	S/T	1.00	0.94	0.79	0.64	1.00	0.94	0.79	0.64	1.00	0.96	0.82	0.67	1.00	1.00	0.84	0.69	1.00	1.00	0.85	0.71	0.99	0.99	0.90	0.76
	ΔT	26	24	20	17	25	23	20	17	25	23	20	16	24	22	19	16	23	22	19	15	24	22	19	16
	kW	1.28	1.28	1.28	1.29	1.48	1.48	1.48	1.49	1.72	1.72	1.72	1.73	1.99	1.98	2.01	2.02	2.29	2.29	2.28	2.30	2.65	2.65	2.65	2.66
1040	Amps	6.1	6.0	6.0	6.1	6.8	6.8	6.8	6.8	7.6	7.6	7.6	7.6	8.5	8.5	8.5	8.5	9.4	9.4	9.4	9.5	10.5	10.5	10.5	10.6
	Hi PR	224	224	226	230	262	263	265	269	304	305	307	311	350	351	352	356	400	401	403	407	455	456	458	462
	Lo PR	135	139	146	158	139	143	150	162	141	145	152	164	142	146	153	165	143	147	154	165	144	148	155	167

770	MBh	25.5	25.9	26.6	27.8	25.1	25.4	26.2	27.3	24.2	24.6	25.3	26.4	22.9	23.3	24.0	25.1	21.4	21.7	22.4	23.5	20.0	20.3	21.0	22.1
	S/T	1.00	1.00	0.78	0.63	1.00	1.00	0.78	0.63	1.00	1.00	0.81	0.65	1.00	1.00	0.82	0.67	1.00	1.00	0.84	0.69	0.99	0.99	0.89	0.74
	ΔT	32	30	26	23	31	29	26	22	31	29	26	22	30	28	25	22	29	27	24	21	29	28	25	22
	kW	1.26	1.26	1.26	1.27	1.47	1.47	1.47	1.48	1.71	1.70	1.70	1.71	1.97	1.97	1.97	1.98	2.27	2.27	2.27	2.28	2.63	2.63	2.63	2.64
	Amps	6.0	6.0	6.0	6.0	6.7	6.7	6.7	6.8	7.5	7.5	7.5	7.6	8.4	8.4	8.4	8.4	9.4	9.4	9.3	9.4	10.5	10.5	10.5	10.5
	Hi PR	220	221	223	226	259	260	261	265	301	301	303	307	346	347	349	353	397	398	399	403	451	452	454	458
85	Lo PR	132	136	143	155	136	140	147	159	138	142	150	161	142	146	153	162	140	144	151	162	142	146	153	164
	MBh	25.9	26.3	27.0	28.2	25.5	25.8	26.6	27.7	24.6	25.0	25.7	26.8	23.3	23.6	24.4	25.5	21.7	22.1	22.8	23.9	20.3	20.7	21.4	22.5
	S/T	1.00	1.00	0.86	0.71	1.00	1.00	0.86	0.71	1.00	1.00	0.88	0.73	1.00	1.00	0.90	0.75	1.00	1.00	0.92	0.77	0.99	0.99	0.97	0.82
	ΔT	30	29	25	22	30	28	25	21	29	28	24	21	29	27	24	20	28	26	23	20	28	27	23	20
	kW	1.27	1.27	1.27	1.28	1.48	1.48	1.48	1.49	1.72	1.71	1.71	1.72	1.98	1.98	2.02	2.03	2.28	2.28	2.28	2.29	2.64	2.64	2.64	2.65
	Amps	6.0	6.0	6.0	6.1	6.8	6.8	6.8	6.8	7.6	7.6	7.6	7.6	8.5	8.4	8.4	8.5	9.4	9.4	9.4	9.4	10.5	10.5	10.5	10.6
900	Hi PR	222	223	225	229	261	262	264	268	303	304	305	309	349	350	351	355	399	400	402	406	454	455	456	461
	Lo PR	134	138	145	157	138	142	149	161	140	144	152	163	142	145	153	164	142	146	153	165	144	148	155	166
	MBh	26.4	26.8	27.5	28.7	26.0	26.3	27.0	28.2	25.1	25.4	26.2	27.3	23.8	24.1	24.8	25.9	22.2	22.6	23.3	24.4	20.8	21.1	21.9	23.0
	S/T	1.00	1.00	0.90	0.75	1.00	1.00	0.90	0.75	1.00	1.00	0.92	0.77	1.00	1.00	0.94	0.79	1.00	1.00	0.96	0.81	0.99	0.99	0.99	0.86
	ΔT	29	27	24	20	29	27	24	20	28	27	23	20	28	26	23	19	27	25	22	19	27	26	22	19
	kW	1.28	1.28	1.28	1.29	1.49	1.49	1.48	1.50	1.72	1.72	1.72	1.73	1.99	1.99	2.03	2.04	2.29	2.29	2.29	2.30	2.65	2.65	2.65	2.66
1040	Amps	6.1	6.1	6.0	6.1	6.8	6.8	6.8	6.8	7.6	7.6	7.6	7.7	8.5	8.5	8.5	8.5	9.4	9.4	9.4	9.5	10.6	10.5	10.5	10.6
	Hi PR	225	225	227	231	263	264	266	270	305	306	308	312	351	352	354	358	401	402	404	408	456	457	459	463
	Lo PR	137	141	148	160	140	144	152	164	143	147	154	166	144	148	155	167	144	148	156	167	146	150	157	168

IDB*: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Airflow may vary depending on actual ambient conditions and system operation modes.

Shaded area is AHRI conditions

kW = Total system power

Amps = outdoor unit amps

IDB*		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		ENTERING INDOOR WET BULB TEMPERATURE																							
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
70	1230	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71			
		MBh	36.8	37.3	38.4		35.8	36.3	37.3		34.1	34.6	35.7		31.9	32.4	33.4		29.4	29.8	30.9				
		S/T	0.67	0.58	0.43		0.66	0.58	0.43		0.68	0.60	0.45		0.69	0.61	0.46		0.70	0.62	0.48				
		ΔT	19	17	14		18	17	14		18	16	13		17	16	13		16	15	12				
		kW	1.92	1.92	1.91		2.19	2.19	2.19		2.50	2.50	2.50		2.85	2.84	2.84		3.23	3.23	3.23				
		Amps	7.6	7.6	7.5		8.7	8.7	8.7		9.9	9.9	9.9		11.3	11.3	11.3		12.8	12.8	12.8				
70	1450	Hi PR	241	242	244		283	284	285		327	328	330		375	376	378		428	429	431				
		Lo PR	128	132	139		132	136	143		135	139	146		136	140	147		137	140	147				
		MBh	37.4	37.9	39.0		36.3	36.8	37.9		34.7	35.2	36.2		32.4	32.9	33.9		29.9	30.4	31.4				
		S/T	0.75	0.67	0.51		0.75	0.66	0.51		0.76	0.68	0.53		0.77	0.69	0.54		0.78	0.70	0.56				
		ΔT	18	16	13		17	15	12		17	15	12		16	14	12		15	14	11				
		kW	1.93	1.93	1.93		2.21	2.21	2.20		2.52	2.52	2.51		2.86	2.86	2.86		3.25	3.25	3.24				
70	1450	Amps	7.6	7.6	7.6		8.7	8.7	8.7		10.0	10.0	10.0		11.4	11.4	11.3		12.9	12.9	12.9				
		Hi PR	244	245	246		285	286	288		329	330	332		378	379	381		431	432	433				
		Lo PR	130	134	142		134	138	145		137	141	148		138	142	149		139	142	150				
		MBh	38.1	38.6	39.7		37.0	37.5	38.6		35.4	35.9	36.9		33.1	33.6	34.6		30.5	31.0	32.0				
		S/T	0.80	0.71	0.56		0.79	0.70	0.55		0.80	0.72	0.57		0.81	0.73	0.58		0.82	0.74	0.60				
		ΔT	17	15	12		16	14	11		16	14	11		15	14	11		14	13	10				
70	1670	kW	1.95	1.95	1.94		2.22	2.22	2.21		2.53	2.53	2.53		2.87	2.87	2.87		3.26	3.26	3.26				
		Amps	7.7	7.7	7.7		8.8	8.8	8.8		10.0	10.0	10.0		11.4	11.4	11.4		13.0	13.0	12.9				
		Hi PR	246	247	249		288	289	290		332	333	335		380	381	383		433	434	436				
		Lo PR	133	137	144		137	141	148		139	143	150		140	144	151		141	145	152				
		MBh	38.1	38.6	39.7		37.0	37.5	38.6		35.4	35.9	36.9		33.1	33.6	34.6		30.5	31.0	32.0				
		S/T	0.80	0.71	0.56		0.79	0.70	0.55		0.80	0.72	0.57		0.81	0.73	0.58		0.82	0.74	0.60				
70	1670	ΔT	17	15	12		16	14	11		16	14	11		15	14	11		14	13	10				
		kW	1.95	1.95	1.94		2.22	2.22	2.21		2.53	2.53	2.53		2.87	2.87	2.87		3.26	3.26	3.26				
		Amps	7.7	7.7	7.7		8.8	8.8	8.8		10.0	10.0	10.0		11.4	11.4	11.4		13.0	13.0	12.9				
		Hi PR	246	247	249		288	289	290		332	333	335		380	381	383		433	434	436				
		Lo PR	133	137	144		137	141	148		139	143	150		140	144	151		141	145	152				
		MBh	38.1	38.6	39.7		37.0	37.5	38.6		35.4	35.9	36.9		33.1	33.6	34.6		30.5	31.0	32.0				
70	1670	S/T	0.80	0.71	0.56		0.79	0.70	0.55		0.80	0.72	0.57		0.81	0.73	0.58		0.82	0.74	0.60				
		ΔT	17	15	12		16	14	11		16	14	11		15	14	11		14	13	10				
		kW	1.95	1.95	1.94		2.22	2.22	2.21		2.53	2.53	2.53		2.87	2.87	2.87		3.26	3.26	3.26				
		Amps	7.7	7.7	7.7		8.8	8.8	8.8		10.0	10.0	10.0		11.4	11.4	11.4		13.0	13.0	12.9				
		Hi PR	246	247	249		288	289	290		332	333	335		380	381	383		433	434	436				
		Lo PR	133	137	144		137	141	148		139	143	150		140	144	151		141	145	152				

75	1230	MBh	36.8	37.3	38.4	40.1	35.8	36.3	37.4	39.0	34.1	34.6	35.7	37.3	31.9	32.4	33.4	35.0	29.4	29.9	30.9	32.4	27.1	27.6	28.6	30.1
		S/T	0.81	0.73	0.57	0.41	0.81	0.72	0.57	0.41	1.02	0.74	0.59	0.43	1.00	0.75	0.60	0.45	0.98	0.76	0.61	0.46	0.96	0.80	0.66	0.51
		ΔT	23	21	18	14	22	20	17	14	22	20	17	14	21	19	16	13	20	18	15	12	20	19	16	13
		kW	1.92	1.92	1.91	1.93	2.19	2.19	2.19	2.20	2.50	2.50	2.50	2.51	2.84	2.84	2.84	2.86	3.23	3.23	3.23	3.25	3.69	3.69	3.69	3.71
		Amps	7.6	7.6	7.5	7.6	8.7	8.7	8.7	8.7	9.9	9.9	9.9	10.0	11.3	11.3	11.3	11.3	12.8	12.8	12.8	12.9	14.7	14.7	14.7	14.7
		Hi PR	241	243	244	248	283	284	286	290	327	328	330	334	375	376	378	383	428	429	431	435	485	486	488	493
1450	1450	Lo PR	128	132	139	151	132	136	143	155	135	139	146	157	136	140	147	158	137	140	147	158	138	142	149	160
		MBh	37.4	37.9	39.0	40.7	36.3	36.8	37.9	39.6	34.7	35.2	36.3	37.9	32.4	32.9	34.0	35.6	29.9	30.4	31.4	33.0	27.6	28.1	29.1	30.6
		S/T	0.90	0.81	0.66	0.50	1.03	0.81	0.66	0.50	1.02	0.82	0.67	0.52	1.00	0.83	0.68	0.53	0.98	0.84	0.69	0.54	0.96	0.87	0.73	0.59
		ΔT	22	20	17	13	21	19	16	13	20	19	16	13	20	18	15	12	19	17	14	11	19	17	15	12
		kW	1.93	1.93	1.93	1.95	2.21	2.21	2.20	2.22	2.52	2.52	2.51	2.53	2.86	2.86	2.85	2.87	3.25	3.25	3.24	3.26	3.71	3.71	3.70	3.72
		Amps	7.6	7.6	7.6	7.7	8.7	8.7	8.7	8.8	10.0	10.0	10.0	10.0	11.4	11.3	11.3	11.4	12.9	12.9	12.9	13.0	14.7	14.7	14.7	14.8
1670	1670	Hi PR	244	245	247	251	285	286	288	292	330	331	332	337	378	379	381	385	431	432	434	438	488	489	491	495
		Lo PR	130	134	142	153	134	138	146	157	137	141	148	159	138	142	149	160	139	142	150	161	140	144	151	162
		MBh	38.1	38.6	39.7	41.4	37.0	37.5	38.6	40.3	35.4	35.9	36.9	38.6	33.1	33.6	34.6	36.2	30.6	31.0	32.1	33.6	28.3	28.7	29.7	31.2
		S/T	0.94	0.86	0.70	0.54	1.03	0.85	0.70	0.54	1.02	0.86	0.71	0.56	1.00	0.87	0.72	0.57	0.98	0.88	0.73	0.58	0.96	0.91	0.77	0.62
		ΔT	20	19	16	12	20	18	15	12	19	18	15	12	19	17	14	11	18	16	13	10	18	17	14	11
		kW	1.95	1.94	1.94	1.96	2.22	2.22	2.21	2.23	2.53	2.53	2.52	2.54	2.87	2.87	2.87	2.89	3.26	3.26	3.26	3.27	3.72	3.72	3.72	3.74
1670	1670	Amps	7.7	7.7	7.7	7.7	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.1	11.4	11.4	11.4	11.5	13.0	12.9	12.9	13.0	14.8	14.8	14.8	14.9
		Hi PR	246	247	249	253	288	289	291	295	332	333	335	339	380	381	383	388	433	434	436	441	491	492	493	498
		Lo PR	133	137	144	156	137	141	148	160	139	143	150	162	140	144	151	163	141	145	152	163	142	146	153	164
		MBh	38.1	38.6	39.7	41.4	37.0	37.5	38.6	40.3	35.4	35.9	36.9	38.6	33.1	33.6	34.6	36.2	30.6	31.0	32.1	33.6	28.3	28.7	29.7	31.2
		S/T	0.94	0.86	0.70	0.54	1.03	0.85	0.70	0.54	1.02	0.86	0.71	0.56	1.00	0.87	0.72	0.57	0.98	0.88	0.73	0.58	0.96	0.91	0.77	0.62
		ΔT	20	19	16	12	20	18	15	12	19	18	15	12	19	17	14	11	18	16	13	10	18	17	14	11

IDB*: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Airflow may vary depending on actual ambient conditions and system operation modes.

Shaded area is ACCA (TVA) conditions

kW = Total system power

Amps = outdoor unit amps

		OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
IDB*	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
1230	MBh	37.0	37.5	38.6	40.3	36.0	36.5	37.6	39.2	34.3	34.8	35.9	37.5	32.1	32.6	33.6	35.2	29.6	30.0	31.1	32.6	27.3	27.7	28.7	30.3
	S/T	1.00	0.87	0.72	0.55	1.00	0.86	0.71	0.55	1.00	0.87	0.73	0.57	1.00	0.88	0.73	0.58	0.98	0.89	0.75	0.59	0.96	0.93	0.79	0.64
	ΔT	27	25	22	18	26	24	21	18	25	24	21	17	24	23	20	17	23	22	19	16	23	22	19	16
	kW	1.92	1.92	1.91	1.93	2.19	2.19	2.19	2.21	2.50	2.50	2.50	2.52	2.85	2.84	2.84	2.86	3.23	3.23	3.23	3.25	3.69	3.69	3.69	3.71
	Amps	7.6	7.6	7.5	7.6	8.7	8.7	8.7	8.7	9.9	9.9	9.9	10.0	11.3	11.3	11.3	11.3	12.8	12.8	12.8	12.9	14.7	14.7	14.7	14.7
80 1450	Hi PR	242	243	245	249	283	284	286	290	328	329	330	335	376	377	379	383	429	430	431	436	486	487	489	493
	Lo PR	129	133	140	151	133	137	144	155	135	139	146	158	136	140	147	159	137	141	148	159	139	143	150	160
	MBh	37.6	38.1	39.2	40.9	36.5	37.0	38.1	39.8	34.9	35.4	36.4	38.1	32.6	33.1	34.2	35.7	30.1	30.6	31.6	33.1	27.8	28.3	29.2	30.8
	S/T	1.00	0.95	0.80	0.64	1.03	0.95	0.79	0.64	1.02	0.96	0.81	0.65	1.00	0.96	0.82	0.66	0.98	0.97	0.83	0.67	0.96	0.96	0.86	0.72
	ΔT	25	24	20	17	25	23	20	16	24	22	19	16	23	21	18	15	22	21	18	15	22	21	18	15
1670	kW	1.93	1.93	1.93	1.95	2.21	2.21	2.20	2.22	2.52	2.52	2.51	2.53	2.85	2.85	2.85	2.87	3.25	3.25	3.24	3.26	3.71	3.71	3.70	3.72
	Amps	7.6	7.6	7.6	7.7	8.7	8.7	8.7	8.8	10.0	10.0	10.0	10.0	11.4	11.3	11.3	11.4	12.9	12.9	12.9	13.0	14.8	14.7	14.7	14.8
	Hi PR	244	245	247	251	286	287	289	293	330	331	333	337	378	379	381	386	431	432	434	439	488	490	491	496
	Lo PR	131	135	142	154	135	139	146	158	137	141	149	160	138	142	150	161	139	143	150	161	141	145	152	163
	MBh	38.3	38.8	39.9	41.6	37.2	37.7	38.8	40.5	35.6	36.1	37.1	38.7	33.3	33.8	34.8	36.4	30.7	31.2	32.2	33.8	28.4	28.9	29.9	31.4
1670	S/T	1.00	1.00	0.84	0.68	1.00	0.99	0.84	0.68	1.02	1.00	0.85	0.69	1.00	1.00	0.86	0.70	0.98	0.98	0.87	0.71	0.96	0.96	0.90	0.75
	ΔT	24	23	19	16	24	22	19	15	23	21	18	15	22	20	18	14	21	20	17	14	21	20	17	14
	kW	1.95	1.94	1.94	1.96	2.22	2.22	2.21	2.23	2.53	2.53	2.53	2.54	2.87	2.87	2.87	2.89	3.26	3.26	3.26	3.28	3.72	3.72	3.72	3.74
	Amps	7.7	7.7	7.7	7.7	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.1	11.4	11.4	11.4	11.5	13.0	13.0	12.9	13.0	14.8	14.8	14.8	14.9
	Hi PR	247	248	250	254	288	289	291	295	332	334	335	340	381	382	384	388	434	435	437	441	491	492	494	498
1670	Lo PR	134	138	145	156	137	141	149	160	140	144	151	163	141	145	152	163	141	145	152	164	143	147	154	165

1230	MBh	37.6	38.1	39.2	40.9	36.6	37.1	38.2	39.8	34.9	35.4	36.5	38.1	32.7	33.2	34.2	35.8	30.1	30.6	31.6	33.2	27.8	28.3	29.3	30.8
	S/T	1.00	0.98	0.83	0.67	1.00	1.00	0.82	0.66	1.00	1.00	0.84	0.68	1.00	1.00	0.84	0.69	0.98	0.98	0.85	0.70	0.96	0.96	0.89	0.74
	ΔT	30	28	25	22	29	27	24	21	28	27	24	21	27	26	23	20	26	25	22	19	26	25	22	19
	kW	1.92	1.92	1.92	1.94	2.20	2.20	2.19	2.21	2.51	2.51	2.50	2.52	2.85	2.85	2.84	2.86	3.24	3.24	3.23	3.25	3.70	3.70	3.69	3.71
	Amps	7.6	7.6	7.6	7.6	8.7	8.7	8.7	8.8	9.9	9.9	9.9	10.0	11.3	11.3	11.3	11.4	12.9	12.9	12.8	12.9	14.7	14.7	14.7	14.8
85 1450	Hi PR	243	244	246	250	284	286	287	292	329	330	331	336	377	378	380	384	430	431	433	437	487	488	490	494
	Lo PR	131	135	142	153	135	138	146	157	137	141	148	160	138	142	149	160	139	143	150	161	140	144	151	162
	MBh	38.2	38.7	39.8	41.5	37.1	37.6	38.7	40.4	35.5	36.0	37.0	38.7	33.2	33.7	34.7	36.3	30.7	31.1	32.2	33.7	28.3	28.8	29.8	31.3
	S/T	1.00	1.05	0.92	0.75	1.00	1.03	0.91	0.75	1.02	1.02	0.92	0.76	1.00	1.00	0.92	0.77	0.98	0.98	0.93	0.78	0.96	0.96	0.96	0.82
	ΔT	29	27	24	20	28	26	23	20	27	26	23	19	26	25	22	19	25	24	21	18	25	24	21	18
1670	kW	1.94	1.94	1.93	1.95	2.21	2.21	2.21	2.23	2.52	2.52	2.52	2.54	2.87	2.86	2.86	2.88	3.26	3.25	3.25	3.27	3.72	3.71	3.71	3.73
	Amps	7.7	7.6	7.6	7.7	8.8	8.8	8.7	8.8	10.0	10.0	10.0	10.1	11.4	11.4	11.4	11.4	12.9	12.9	12.9	13.0	14.8	14.8	14.7	14.8
	Hi PR	246	247	248	252	287	288	290	294	331	332	334	338	380	381	382	387	432	434	435	440	490	491	493	497
	Lo PR	133	137	144	156	137	141	148	160	139	143	150	162	140	144	151	163	141	145	152	163	142	146	153	164
	MBh	38.9	39.4	40.5	42.2	37.8	38.3	39.4	41.1	36.2	36.7	37.7	39.3	33.9	34.4	35.4	37.0	31.3	31.8	32.8	34.4	29.0	29.5	30.5	32.0
1670	S/T	1.00	1.05	0.96	0.80	1.00	1.00	0.95	0.79	1.00	1.00	0.96	0.80	1.00	1.00	0.97	0.81	0.98	0.98	0.97	0.82	0.96	0.96	0.96	0.86
	ΔT	28	26	23	19	27	25	22	19	26	25	22	18	25	24	21	18	24	23	20	17	24	23	20	17
	kW	1.95	1.95	1.95	1.96	2.23	2.22	2.22	2.24	2.54	2.53	2.53	2.55	2.88	2.88	2.87	2.89	3.27	3.27	3.26	3.28	3.73	3.73	3.72	3.74
	Amps	7.7	7.7	7.7	7.8	8.8	8.8	8.8	8.9	10.1	10.1	10.0	10.1	11.4	11.4	11.4	11.5	13.0	13.0	13.0	13.0	14.8	14.8	14.8	14.9
	Hi PR	248	249	251	255	289	290	292	296	334	335	336	341	382	383	385	389	435	436	438	442	492	493	495	500
	Lo PR	136	140	147	159	139	143	151	162	142	146	153	164	143	147	154	165	143	147	154	166	145	148	156	167

IDB*: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

Airflow may vary depending on actual ambient conditions and system operation modes.

Shaded area is AHRI conditions

kW = Total system power

Amps = outdoor unit amps

EXPANDED HEATING DATA — NORMAL HEATING MODE

DH9VSA241CA* + CAHEA3630*3A*, MBVK16CH*X00A*

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	31.3	29.1	27.1	25.2	24.0	23.3	21.5	41.8	38.9	36.0	33.2	31.5	30.5	27.8	24.0	22.6	20.1	15.9
T/R	31	29	27	25	24	23	21	42	39	36	33	32	30	28	25	22	20	16
KW	1.74	1.72	1.71	1.69	1.68	1.56	1.54	3.77	3.63	3.48	3.34	3.26	3.21	3.08	2.93	2.83	2.72	2.34
AMPS	5.4	5.4	5.3	5.2	5.2	5.1	5.1	14.9	14.3	13.7	13.0	12.7	12.5	11.9	11.3	10.8	10.3	8.6
COP	5.62	5.29	4.96	4.67	4.48	4.37	4.09	3.25	3.14	3.03	2.91	2.83	2.78	2.65	2.40	2.34	2.17	1.99

DH9VSA361CA* + CAHEA3630*3A*, MBVK16CH*X00A*

	OUTDOOR AMBIENT TEMPERATURE																	
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5	-10
MBh	45.2	42.2	39.3	36.5	34.2	33.8	31.3	57.3	53.2	49.3	45.5	43.2	41.7	38.3	34.2	31.2	26.6	18.9
T/R	28	26	24	22	21	20	19	35	33	30	28	26	25	23	21	19	16	11
KW	2.46	2.45	2.43	2.41	2.39	2.30	2.27	5.22	5.04	4.85	4.68	4.57	4.50	4.34	4.18	3.98	3.62	2.81
AMPS	8.0	7.9	7.8	7.7	7.7	7.6	7.5	20.6	19.7	18.9	18.2	17.7	17.4	16.7	15.9	15.1	13.5	9.9
COP	5.57	5.21	4.90	4.58	4.34	4.31	4.04	3.22	3.09	2.98	2.85	2.77	2.72	2.58	2.40	2.30	2.15	1.98

Calculations are based on nominal CFM and 70 °F indoor dry bulb.

Note: Shaded area is AHRI Rating Conditions at 47°F outdoor ambient temperature

Amps = Outdoor unit amps (comp.+fan)

KW= Total system power

DH9VSA241CA* + CAHEA3630*3A*, MBVK16CH*X00A*

	OUTDOOR AMBIENT TEMPERATURE							
	65	60	55	50	47	45	40	35 OR LOWER
MBh	55.8	52.1	51.2	47.6	45.6	44.3	41.1	Same as normal heating mode
T/R	31	29	28	26	25	24	22	
KW	3.24	3.20	3.38	3.32	3.28	3.26	3.19	
AMPS	11.3	11.1	11.9	11.7	11.5	11.4	11.1	
COP	5.05	4.77	4.44	4.20	4.07	3.98	3.77	

DH9VSA361CA* + CAHEA3630*3A*, MBVK16CH*X00A*

	OUTDOOR AMBIENT TEMPERATURE							
	65	60	55	50	47	45	40	35 OR LOWER
MBh	70.1	65.6	64.5	60.2	57.7	56.0	52.2	Same as normal heating mode
T/R	44	41	40	38	36	35	32	
KW	4.86	4.71	4.98	4.81	4.72	4.65	4.50	
AMPS	18.9	18.2	19.4	18.7	18.3	18.0	17.4	
COP	4.23	4.08	3.80	3.67	3.58	3.53	3.40	

Calculations are based on nominal CFM and 70 °F indoor dry bulb.

Note: Shaded area is AHRI Rating Conditions at 47°F outdoor ambient temperature

Amps = Outdoor unit amps (comp.+fan)

KW= Total system power

PERFORMANCE DATA FOR STANDARD OPERATING MODE

DH9VSA241CA* / CAHEA3630*3A*, MBVK16CH*X00A* DESIGN SUBCOOLING @ AHRI 95°F CONDITIONS 5-7°F AT 100% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	26,100	19,600	6,500	1,470
80°	25,700	19,700	6,000	1,600
85°	25,300	19,700	5,600	1,710
90°	24,700	19,500	5,200	1,800
95°	24,000	19,200	4,800	1,970
100°	23,200	18,800	4,400	2,100
105°	22,400	18,400	4,000	2,280
110°	21,700	18,400	3,300	2,500
115°	21,000	18,300	2,700	2,640
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	23,100	18,700	4,400	1,970

DH9VSA241CA* / CAHEA3630*3A*, MBVK16CH*X00A* DESIGN SUBCOOLING @ AHRI 95°F CONDITIONS 5-7°F IN BOOST MODE				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	26,100	19,600	6,500	1,470
80°	25,700	19,700	6,000	1,600
85°	25,300	19,700	5,600	1,710
90°	24,700	19,500	5,200	1,800
95°	24,000	19,200	4,800	1,970
100°	23,200	18,800	4,400	2,100
105°	22,400	18,400	4,000	2,280
110°	21,700	18,400	3,300	2,500
115°	21,000	18,300	2,700	2,640
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	23,100	18,700	4,400	1,970

DH9VSA361CA* / CAHEA3630*3A*, MBVK16CH*X00A* DESIGN SUBCOOLING @ AHRI 95°F CONDITIONS 9-11°F AT 100% DEMAND				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	38,100	30,100	8,000	2,200
80°	37,300	29,800	7,500	2,400
85°	36,400	29,500	6,900	2,510
90°	35,300	28,800	6,500	2,700
95°	34,200	28,000	6,200	2,850
100°	32,900	27,100	5,800	3,000
105°	31,600	26,200	5,400	3,240
110°	30,400	25,700	4,700	3,500
115°	29,200	25,100	4,100	3,700
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	32,900	27,300	5,600	2,860

DH9VSA361CA* / CAHEA3630*3A*, MBVK16CH*X00A* DESIGN SUBCOOLING @ AHRI 95°F CONDITIONS 9-11°F IN BOOST MODE				
OUTDOOR TEMP °F	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75°	41,000	31,200	9,800	2,200
80°	40,200	30,900	9,300	2,300
85°	39,200	30,400	8,800	2,500
90°	38,000	29,600	8,400	2,600
95°	36,000	28,800	7,900	3,000
100°	35,400	28,400	7,000	3,400
105°	34,000	26,800	7,200	3,100
110°	32,600	26,200	6,400	3,400
115°	31,500	26,000	5,500	3,600
TVA Conditions @ 95° OD DB, 75° ID, 63° ID WB				
95°	35,400	28,000	7,400	2,800

NORMAL MODE - COOLING		SOUND POWER LEVEL ¹						
TONNAGE	TOTAL UNIT SOUND RATING (dBA)	OCTAVE BAND SPECTRUM FREQUENCY (Hz) ANALYSIS (dB)						
		125	250	500	1000	2000	4000	8000
2-ton	71	71.8	70.9	70.4	65.6	60.4	51.5	43.7
3-ton	71	71.8	71.7	70.2	65.7	60.5	51.7	44.6

¹Compliant with AHRI 270.²Compliant with AHRI 220.

NORMAL MODE - HEATING		SOUND POWER LEVEL ¹						
TONNAGE	TOTAL UNIT SOUND RATING (dBA)	OCTAVE BAND SPECTRUM FREQUENCY (Hz) ANALYSIS (dB)						
		125	250	500	1000	2000	4000	8000
2-ton	75	76.1	76.7	73.8	69.1	63.8	56.0	48.4
3-ton	75	76.1	76.7	73.8	69.1	63.8	56.1	49.0

¹ Compliant with AHRI 270.²Compliant with AHRI 220.

QUIET MODE_COOLING


TONNAGE	SOUND SUPPRESSION LEVEL	SOUND POWER LEVEL (dBA)1	SOUND PRESSURE LEVEL (dBA)2
2-ton	LV.1	69	53
	LV.2	66	50
	LV.3	63	47
3-ton	LV.1	69	53
	LV.2	66	50
	LV.3	63	47

¹Quiet Mode Sound Power and Sound Pressure levels determined at a distance of 3 [ft].

QUIET MODE_HEATING

TONNAGE	SOUND SUPPRESSION LEVEL	SOUND POWER LEVEL (dBA)1	SOUND PRESSURE LEVEL (dBA)2
2-ton	LV.1	72	56
	LV.2	69	53
	LV.3	66	50
3-ton	LV.1	72	56
	LV.2	69	53
	LV.3	66	50

¹Quiet Mode Sound Power and Sound Pressure levels determined at a distance of 3 [ft].

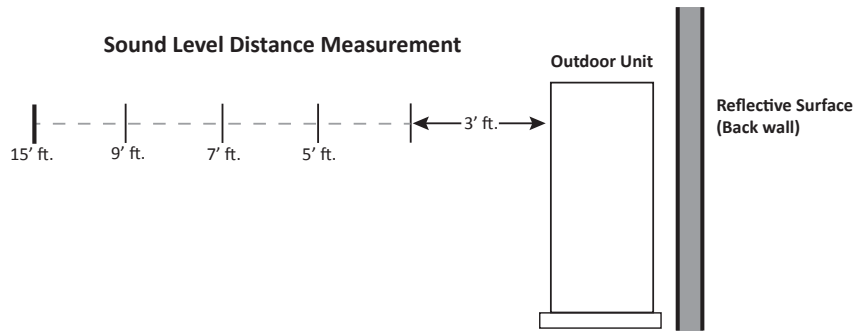

		SOUND PRESSURE (dBA) COOLING MODE ¹				
		DISTANCE FROM PROPERTY LINE				
TONNAGE	REFLECTIVE SURFACE QTY.	3'	5'	7'	9'	15'
2.0 Ton	0	64	59	56	54	50
	1	67	62	59	57	53
	2	70	65	62	60	56
3.0 Ton	0	64	59	56	54	50
	1	67	62	59	57	53
	2	70	65	62	60	56


¹ Compliant with AHRI 275 utilizing standard mode, total sound levels


		SOUND PRESSURE (dBA) HEATING MODE ¹				
		DISTANCE FROM PROPERTY LINE				
TONNAGE	REFLECTIVE SURFACE QTY.	3'	5'	7'	9'	15'
2.0 Ton	0	68	63	60	58	54
	1	71	66	63	61	57
	2	74	69	66	64	60
3.0 Ton	0	68	63	60	58	54
	1	71	66	63	61	57
	2	74	69	66	64	60

¹ Compliant with AHRI 275 utilizing standard mode, total sound levels

***ALL AHRI SYSTEM RATINGS ARE ACCESSIBLE IN THE UNITARY MATCHUP TOOL VIA
DAIKIN CITY OR IN THE DAIKIN SYSTEM CONFIGURATOR TOOL VIA PARTNERLINK.***

MODEL	DIMENSIONS		
	W"	D"	H"
DH9VSA241CA*	37	12 $\frac{5}{8}$	56 $\frac{5}{16}$
DH9VSA361CA*	37	12 $\frac{5}{8}$	56 $\frac{5}{16}$

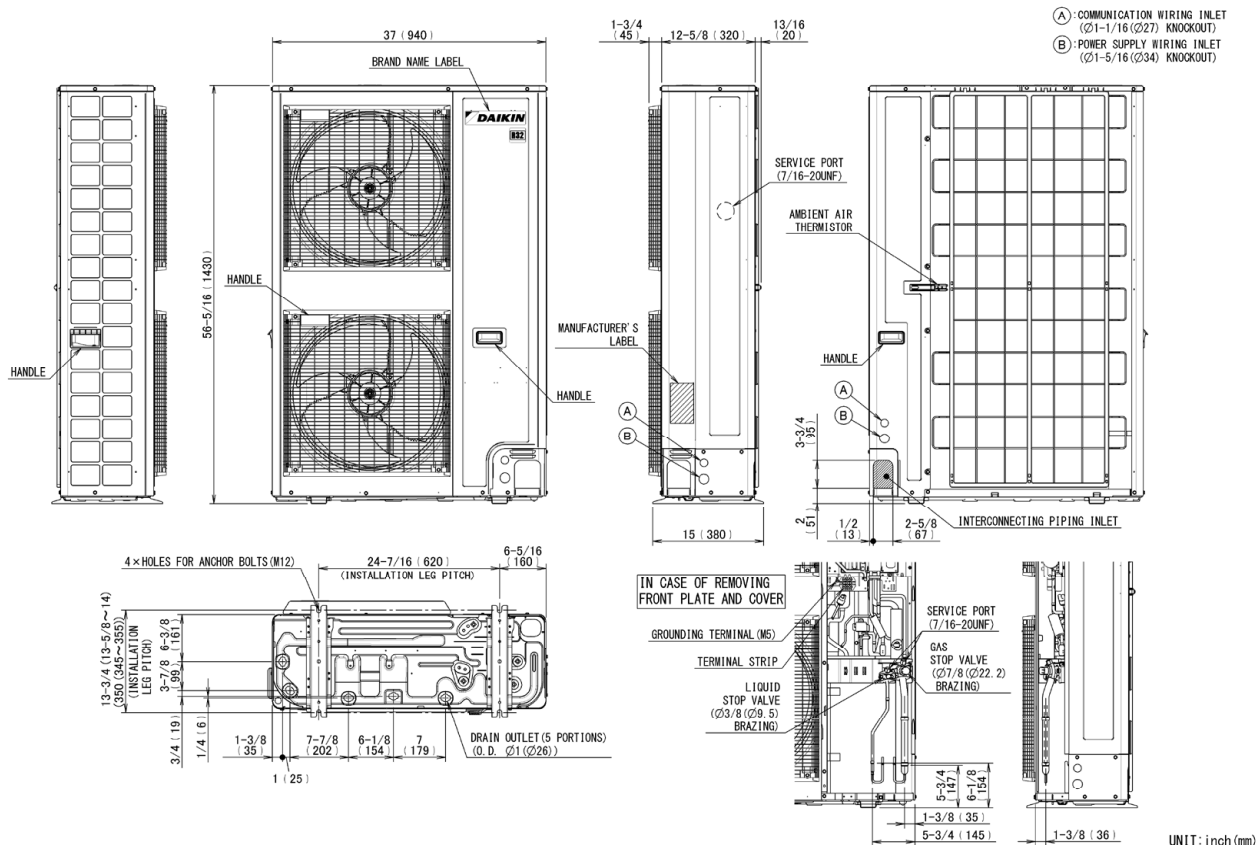

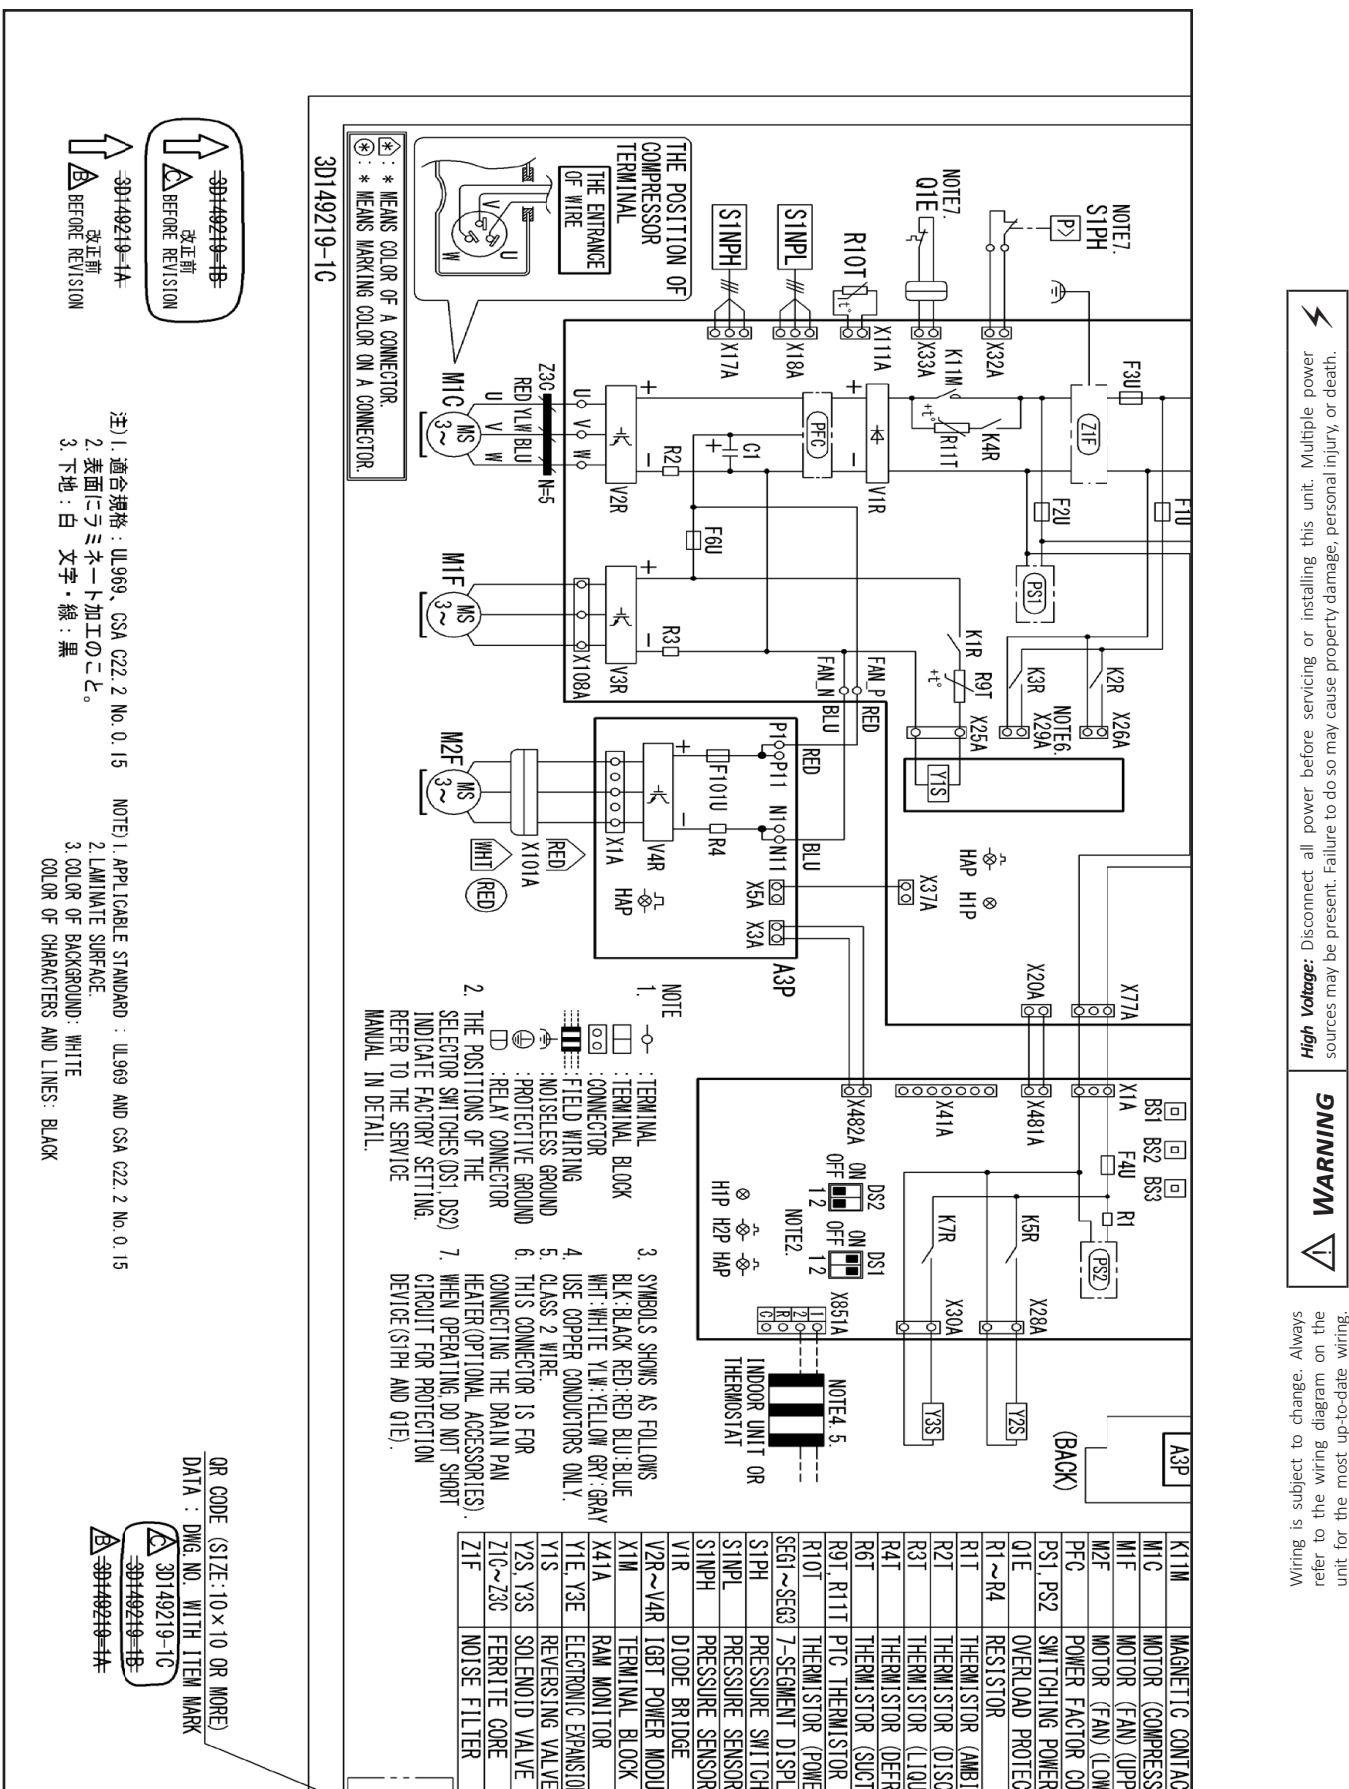

MODEL	DESCRIPTION	DH9VSA 241CA*	DH9VSA 361CA*
KPW5G112	Wind Baffle	X ² (2)	X ² (2)
3K020967-2 ¹	Snow Guard Front	X	X
3P434587-5 ¹	Snow Guard Rear	X	X
3P434588-1 ¹	Snow Guard Side	X	X
0270R02063 (130-DK-017)	Hail Guard	X	X
KEH3P648291	Drain Pan Heater	X	X
DSEN-HAQA	Daikin One Home Air Monitor	X	X

¹ Product is manufactured at time of order. Lead time will be associated with purchase.

² Please ensure that 2 nos (KPW5G112) are ordered for each model when placing the order.

This image shows a single sheet of white paper with horizontal ruling lines. The lines are evenly spaced and run across the width of the page. There are no margins, text, or other markings on the paper.

[illegible]

[illegible]